

# USR-IO808-GR User Manual

File Version: V1.0.5.01



## Contents

<b>USR-IO808-GR User Manual</b> .....	<b>1</b>
<b>Features</b> .....	<b>3</b>
<b>1. Get Start</b> .....	<b>4</b>
<b>1.1. Product introduction</b> .....	<b>4</b>
<b>1.2. Basic parameters</b> .....	<b>4</b>
<b>1.3. Hardware</b> .....	<b>5</b>
<b>1.3.1. Interface</b> .....	<b>5</b>
<b>1.3.2. LED</b> .....	<b>5</b>
<b>1.3.3. Dimension</b> .....	<b>6</b>
<b>1.4. Test</b> .....	<b>7</b>
<b>1.4.1. Control by serial</b> .....	<b>7</b>
<b>1.4.2. Control by USR Cloud</b> .....	<b>9</b>
<b>2. Product function</b> .....	<b>11</b>
<b>2.1. DI input</b> .....	<b>11</b>
<b>2.1.1. Electrical level detection</b> .....	<b>11</b>
<b>2.1.2. Buttons detection</b> .....	<b>11</b>
<b>2.1.3. Pulse counting</b> .....	<b>12</b>
<b>2.2. DO output</b> .....	<b>12</b>
<b>2.3. Work mode</b> .....	<b>12</b>
<b>2.3.1. Master mode</b> .....	<b>12</b>
<b>2.3.2. Slave mode</b> .....	<b>14</b>
<b>2.4. Upgrade firmware</b> .....	<b>15</b>
<b>2.5. Serial port</b> .....	<b>16</b>
<b>2.5.1. Basic parameters</b> .....	<b>16</b>
<b>2.5.2. Configuration method</b> .....	<b>16</b>
<b>2.6. Features</b> .....	<b>16</b>
<b>2.6.1. Relay output status hold</b> .....	<b>16</b>
<b>2.6.2. Conditional control</b> .....	<b>17</b>
<b>2.6.3. Connect to remote server</b> .....	<b>18</b>
<b>2.6.4. Reset to default by hardware</b> .....	<b>19</b>
<b>3. Modbus</b> .....	<b>19</b>
<b>3.1. Modbus frame</b> .....	<b>20</b>
<b>3.2. Register distribution</b> .....	<b>20</b>
<b>4. Contact Us</b> .....	<b>23</b>
<b>5. Disclaimer</b> .....	<b>23</b>
<b>6. Update History</b> .....	<b>23</b>

## Features

- Support 8-way Relay output
- Support 8-way input, default is dry contact
- Support 8 conditional control command
- Support various function code: 0x01, 0x02, 0x03, 0x04, 0x05, 0x06, 0x0F, 0x10
- Support socket to connect to remote server and TCP Client
- Support two work modes: Master mode and Slave mode. Master mode supports connecting to multiple Modbus RTU devices by RS485 cascading connection.
- Adopt Modbus RTU protocol data processing. Support Modbus TCP/RTU protocol adaptation.
- Support connecting to USR Cloud.
- Support FTP remote upgrade.
- Support upgrading by RS485.
- Support hardware watchdog.
- Support various LED to indicate work status.
- Support power supply over-current, over-voltage, anti-reverse connection protection.

## 1. Get Start

If user has any question, please submit it back to customer center: [h.usriot.com](http://h.usriot.com).

### 1.1. Product introduction

USR-IO808-GR is network IO product which supports 8-way input/output and Modbus RTU/TCP protocol. Take 'Remote control' as core function and have high usability. User can easily and quickly integrate USR-IO808-GR into own system to realize remote control which based on GPRS network.


### 1.2. Basic parameters

Parameter		Value
<b>Wireless parameters</b>	Wireless standard	GSM/GPRS
	Standard frequency band	850/900/1800/1900MHz
	Transmitting power	GSM900 class4(2W)
		DCS1800 class1(1W)
	GPRS Terminal Device Class	Class B
	GPRS Multi-slot Class	GPRS Class 10
GPRS Coding Schemes	CS1~CS4	
<b>Hardware parameters</b>	Data interface	Serial port: Support RS485. Baud rate: 300bps~230400bps
	Working voltage	12V~36V
	Working temperature	-20℃ ~ +70℃
	Storage temperature	-40℃ ~ +85℃
	Working humidity	5%~95%
	Storage humidity	1%~95%
	Dimension	200*122*29mm
<b>Software parameters</b>	Wireless network type	GSM/GPRS
	Work mode	Master mode, slave mode
	Configuration command	Modbus RTU
	Network protocol	Modbus TCP, Modbus RTU
	Application software	Support configuration software
<b>Software function</b>	DNS	Support
	Data transmission mode	Support TCP Client
<b>EMC level</b>	ESD	IEC61000-4-2, Level 4
	Surge	IEC61000-4-5, Level 3
	Group pulse	IEC61000-4-4, Level 3

**Figure 1 Basic parameters**

## 1.3. Hardware

### 1.3.1. Interface

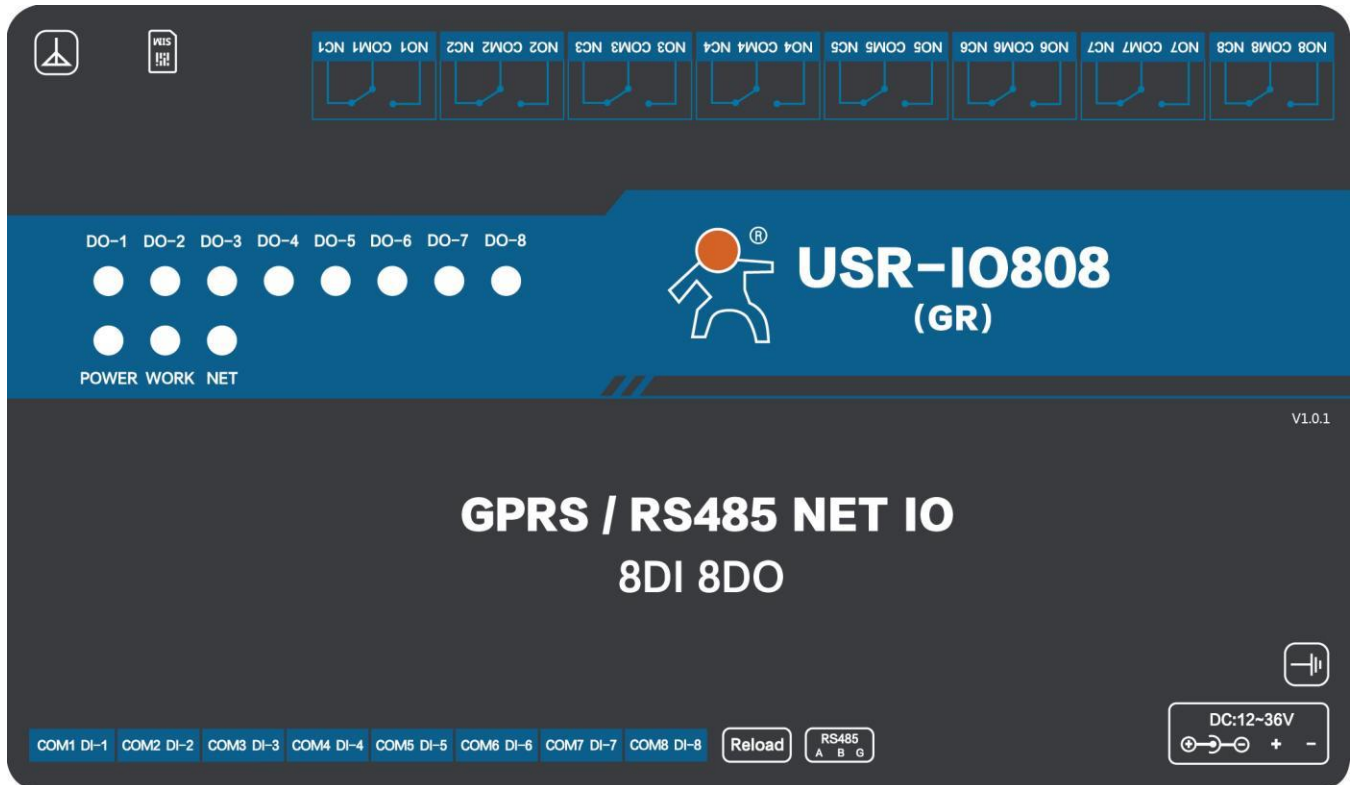

**Figure 2 Product interface diagram**

- Antenna: GPRS antenna
- SIM card slot
- RS485: RS485 interface
- DO: DO1~DO8 are 8-way Relay output
- DI: 8-way input, default is dry contact
- DC: 12-36V. DC 12~36V power supply. Low power supply will cause IO808-GR can't start.

### 1.3.2. LED

LED	Function	Status
POWER	Indicate power status	Light after powering module
WORK	Indicate system running status	Blink every 1 second after product system running; Blink every 0.2 second during upgrading firmware process.
NET	Indicate network connection status	Light after connecting to remote server

**Figure 3 LED**

### 1.3.3. Dimension



Figure 4 Dimension diagram

Fixed installation diagram as follow:


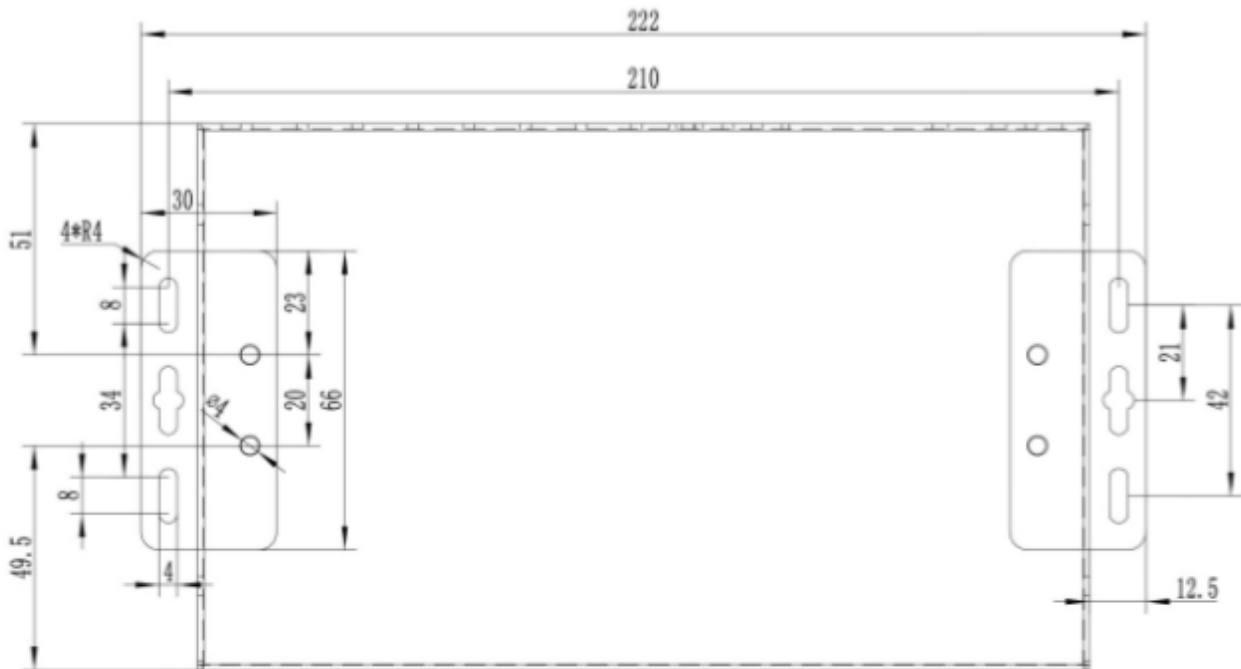


Figure 5 Fixed installation diagram

## 1.4. Test

User can refer to following application diagram to test the USR-IO808-GR.

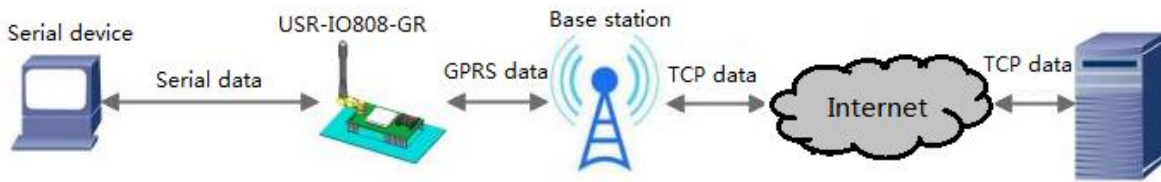

**Figure 6 Test diagram**

- Connect PC to USR-IO808-GR by USB -> RS485 cable
- Insert SIM card before powering IO808-GR
- Power the IO808-GR(Range from DC 12V to DC 36V)
- After powering on, use Modbus protocol to control IO808-GR by serial.


Initial parameters:

Work mode	Network data transparent transmission
Server address	clouddata.usr.cn
Remote port	15000
RS485 serial port parameters	9600, 8, 1, None

**Figure 7 Initial parameters**


### 1.4.1. Control by serial

Power IO808-GR and connect IO808-GR's RS485 interface to PC. Run setup software **USR-IO V1.0.28.exe** and choose IO808-GR. Choose correct COM and configure correct serial port parameters as follow(Default settings is 9600, None, 8, 1):

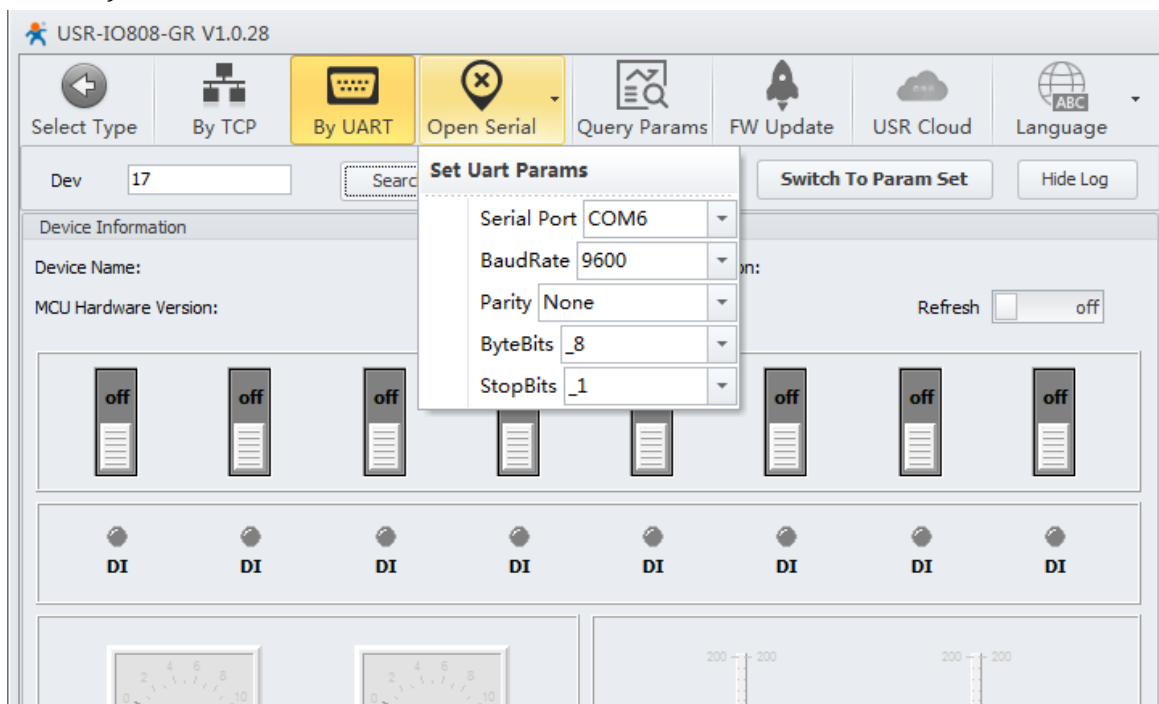


**Figure 8 Open serial**

After opening serial port, click 'Search' to search IO808-GR and click '停止' to stop searching after finding IO808-GR. Then choose IO808-GR as follow:

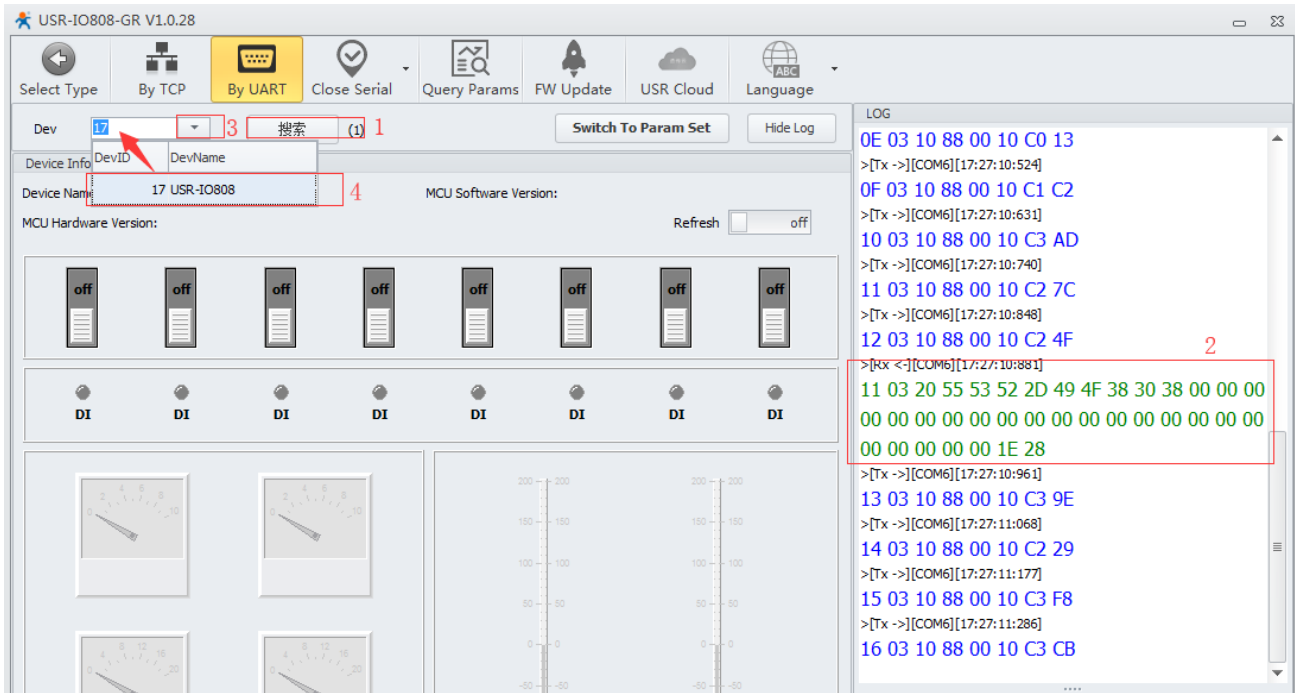

**Figure 9 Search IO808-GR**


Then user can control devices.

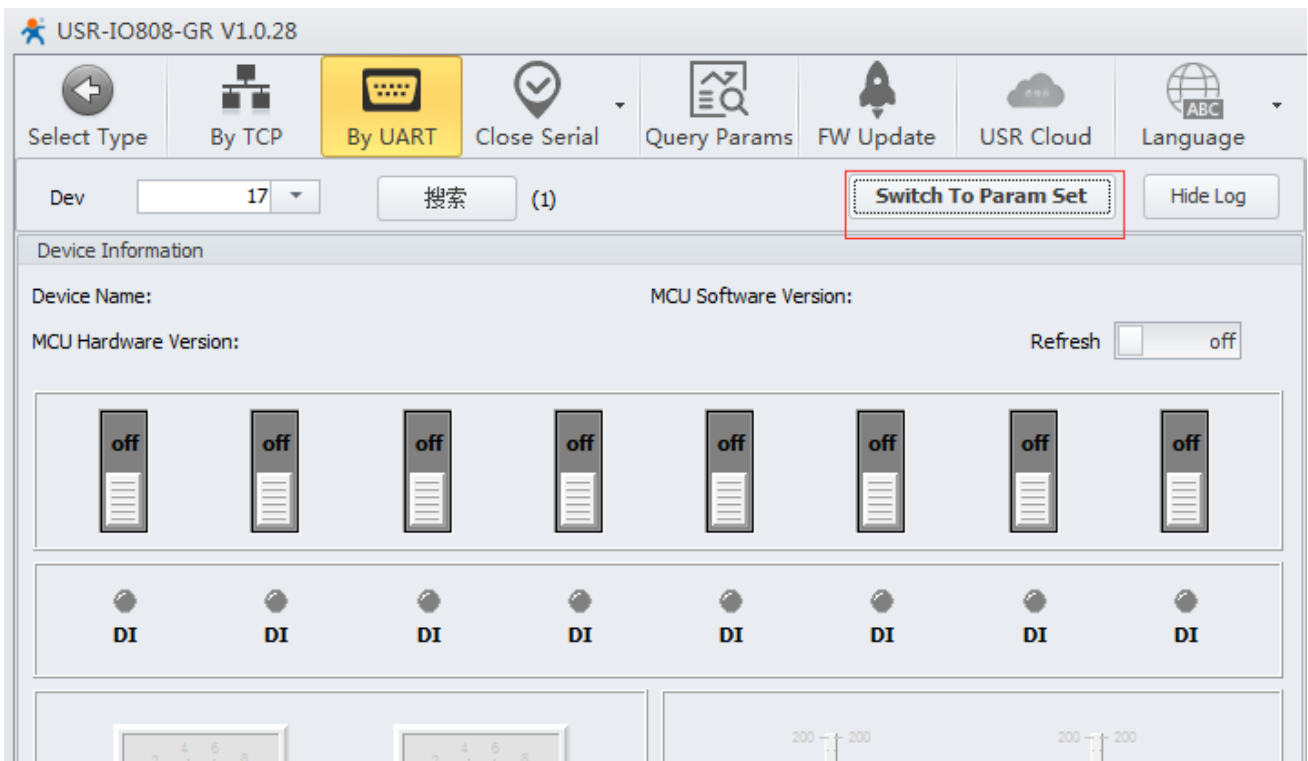

**Figure 10 Control devices**

User can also click 'Switch To Param Set' on above figure to enter IO808-GR configuration page.




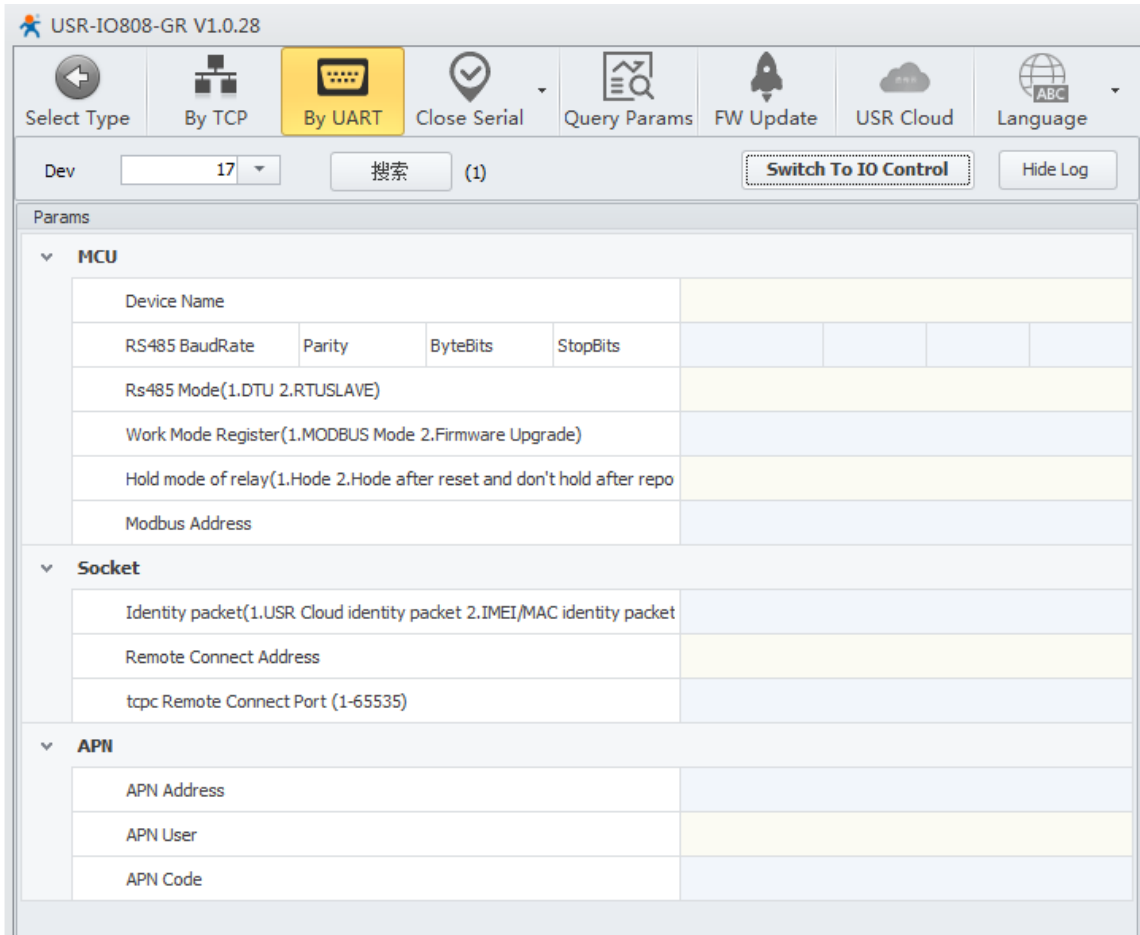

**Figure 11 Configuration page**

### 1.4.2. Control by USR Cloud

User can type <http://console.usr.cn/> into browser address bar to enter USR Cloud web page and login with username and password. Then user can add device as follow:

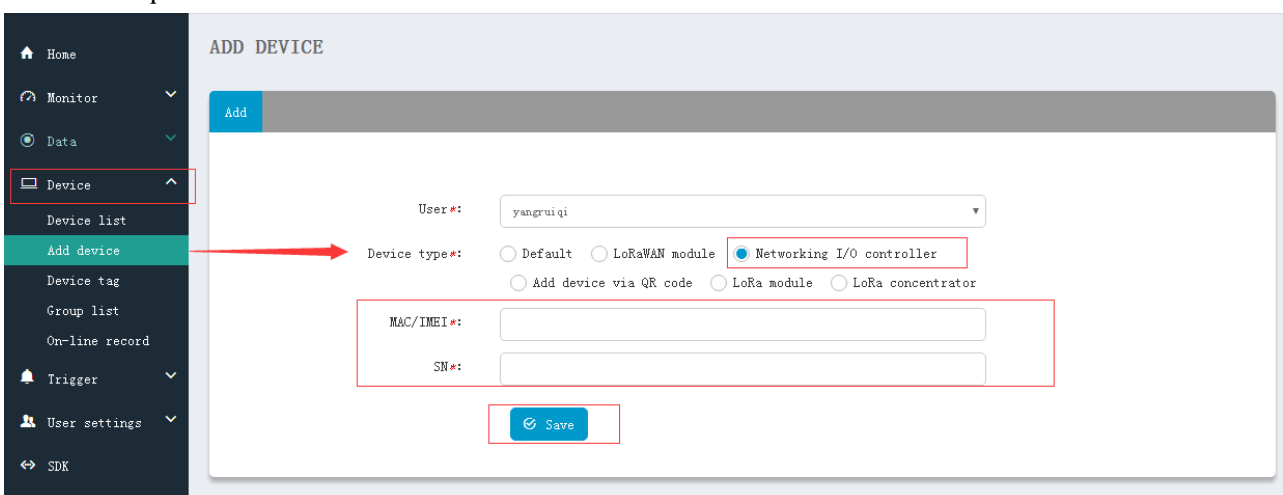

**Figure 12 Add IO808-GR**

Choose 'Networking I/O controller' as 'Device type', write IMEI and SN on IO808-GR's label and click 'Save' to add IO808-GR.

After adding IO808-GR, power IO808-GR and wait LED 'NET' light which means IO808-GR connects to USR Cloud. Then user can remotely look over, record and control IO808-GR status in real time through USR Cloud(Monitor->Data list).

## 2. Product function

USR-IO808-GR functional diagram as follow:

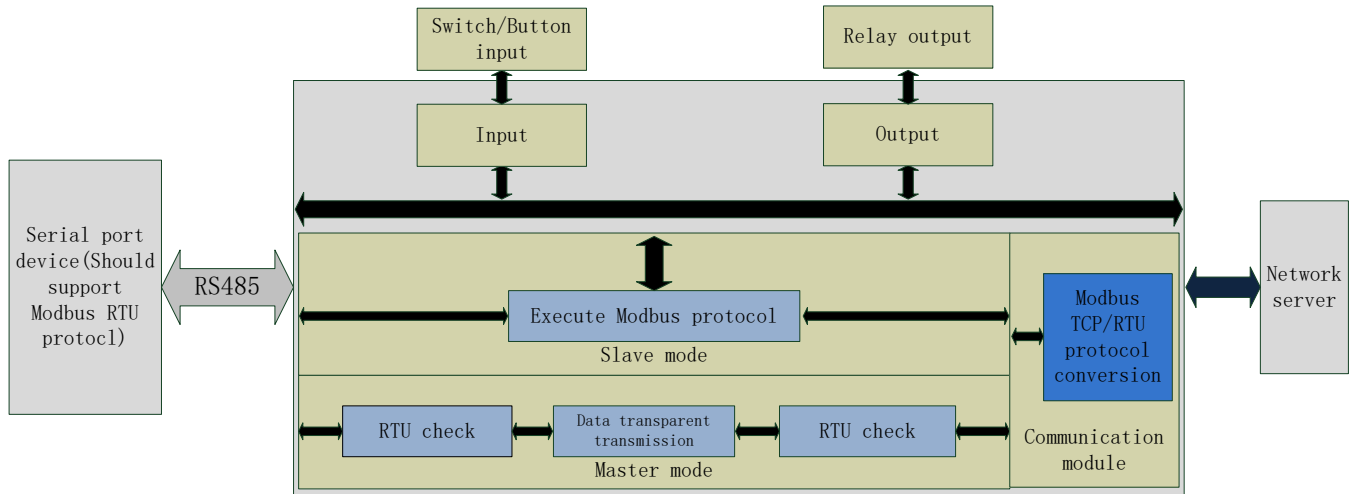


Figure 13 Functional diagram

### 2.1. DI input

#### 2.1.1. Electrical level detection

- Register address range: 32~39(0x0020~0x0027)
- Supported function code: 02(Read discrete input), 03(Read holding register)
- Connection: Default is dry contact input. Short-circuit DI and COM will change input status. If user needs wet contact input can contact to our sales personnel
- Electrical level detection: Default status is 0, after short-circuiting DI and COM, status will be 1. Detection method: 02 function code of Modbus protocol.

Example:

Detect input of the first way, send: 11 02 00 20 00 01 BA 90

Short-circuiting will return: 11 02 01 01 64 88

No short-circuiting will return: 11 02 01 00 A5 48

#### 2.1.2. Buttons detection

- Register address range: 48~55(0x0030~0x0037)
- Supported function code: 03(Read holding register), 04(Read input register)
- Connection: Default is dry contact input. Short-circuit DI and COM will change input status. If user needs wet contact input can contact to our sales personnel
- Electrical level detection: Default status is 0000, after short-circuiting DI and COM and then releasing, status will be FF00. Detection method: Read button register value by 03 function code of Modbus protocol. After reading once button register, status will recover to 0000; after executing conditional control, status will recover to 0000. too.

Example:

Detect the first way button, send: 11 03 00 30 00 01 86 95

No button will return: 11 03 02 00 00 79 87

Have button will return: 11 03 02 FF 00 38 77

### 2.1.3. Pulse counting

- Register address range: 64~71(0x0040~0x0047)
- Supported function code: 03(Read holding register), 04(Read input register)
- Connection: Default is dry contact input. Short-circuit DI and COM will change input status. If user needs wet contact input can contact to our sales personnel
- Pulse counting: Default status is 0, short-circuit DI and COM and then release will count 1. Detection method: Read pulse counting register value by 03 function code of Modbus protocol. Maximum value of pulse counting is 65535 and it will restart counting after exceeding 65535. Can't reset count to 0 and restart product won't save count.
- **Note:** Pulse counting won't filter input waveform and all pulse in the range of detection will be recorded. So input waveform should keep stable to ensure accurate count.

Example:

Detect count of the first way, send: 11 03 00 40 00 01 87 4E

Return: 11 03 02 00 00 79 87

## 2.2. DO output

- Register address range: 00~07(0x0000~0x0007)
- Supported function code: 01(Read coil), 05(Write single coil), 0F(Write multiple coil)
- Connection: DO output is Relay passive output. Don't power the coil, Relay COM and NC will close, COM and NO will open. After powering, the contrary is the case.

Take the first way Relay control as example:

Query: 11 01 00 00 00 04 3F 59

Control to close: 11 05 00 00 FF 00 8E AA


Control to disconnect: 11 05 00 00 00 00 CF 5A

## 2.3. Work mode


Default work mode of USR-IO808-GR is slave mode. IO808-GR will be slave both on network side and RS485 side and IO808-GR will discard data if IO808-GR receives data not for IO808-GR local address.

### 2.3.1. Master mode

Master mode data flow diagram and connecting to network diagram as follows:

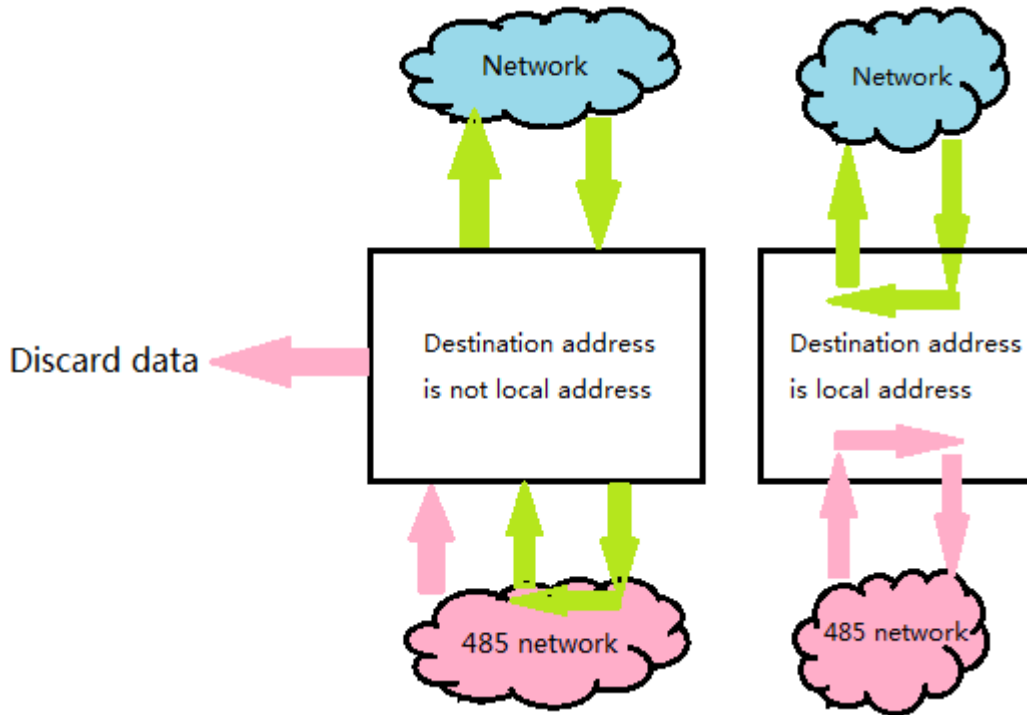


**Figure 14 Master mode data flow**

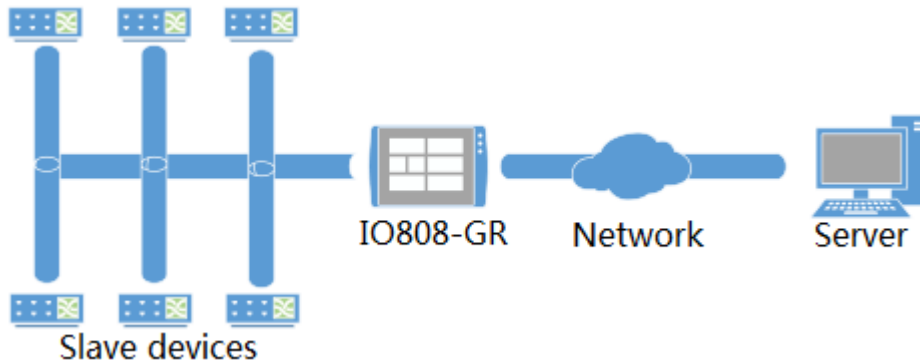

**Figure 15 Connecting to network in Master mode**

In master mode, after IO808-GR receiving data, it will judge destination address firstly. If destination address is local address, IO808-GR will process data; if destination address isn't local address, IO808-GR will forward data. In this mode, user can connect to multiple slave devices by RS485 cascading connection.


User can configure IO808-GR to Master mode by setup software as follow(Configure RS485 mode to 1.DTU):

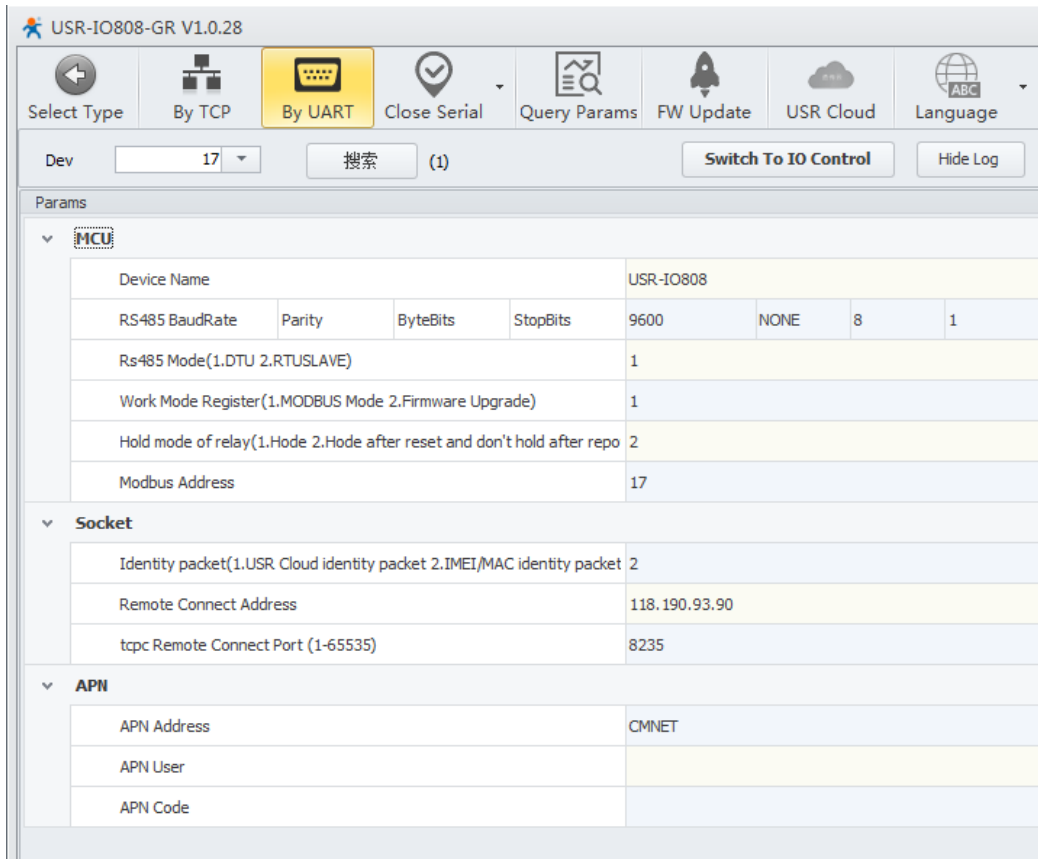

**Figure 16 Configure IO808-GR to Master mode**

### 2.3.2. Slave mode

Slave mode data flow diagram and connecting to network diagram as follows:

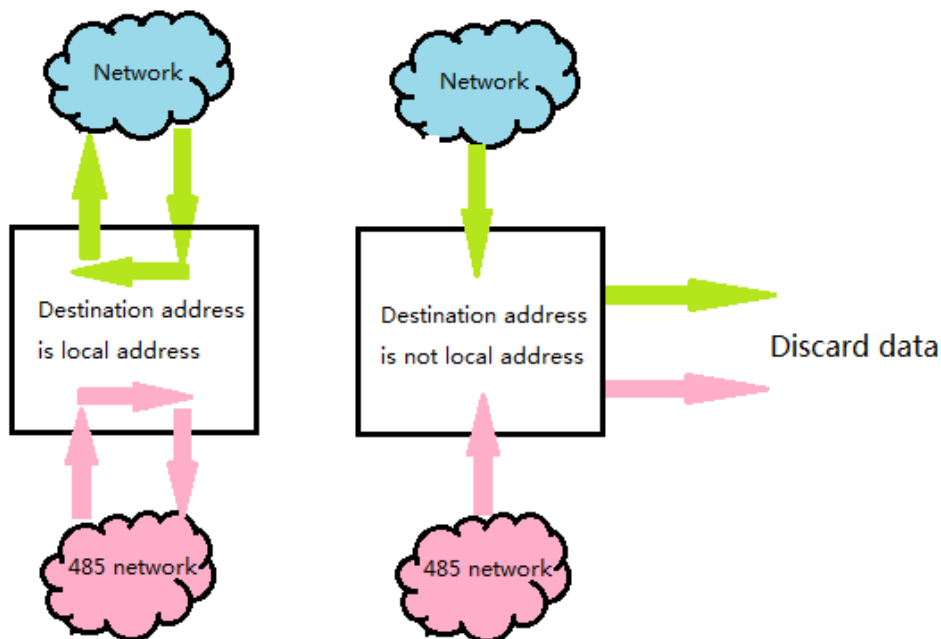


**Figure 17 Slave mode data flow**



**Figure 18 Connecting to network in Slave mode**

In this mode, IO808-GR can connect to master device or work as single device. In this mode, IO808-GR will analyse and process received data. If destination address is local address, IO808-GR will make a corresponding reaction; if destination address isn't local address, IO808-GR will discard data.

User can configure IO808-GR to slave mode by setup software as follow(Configure RS485 mode to 2.RTUSLAVE):

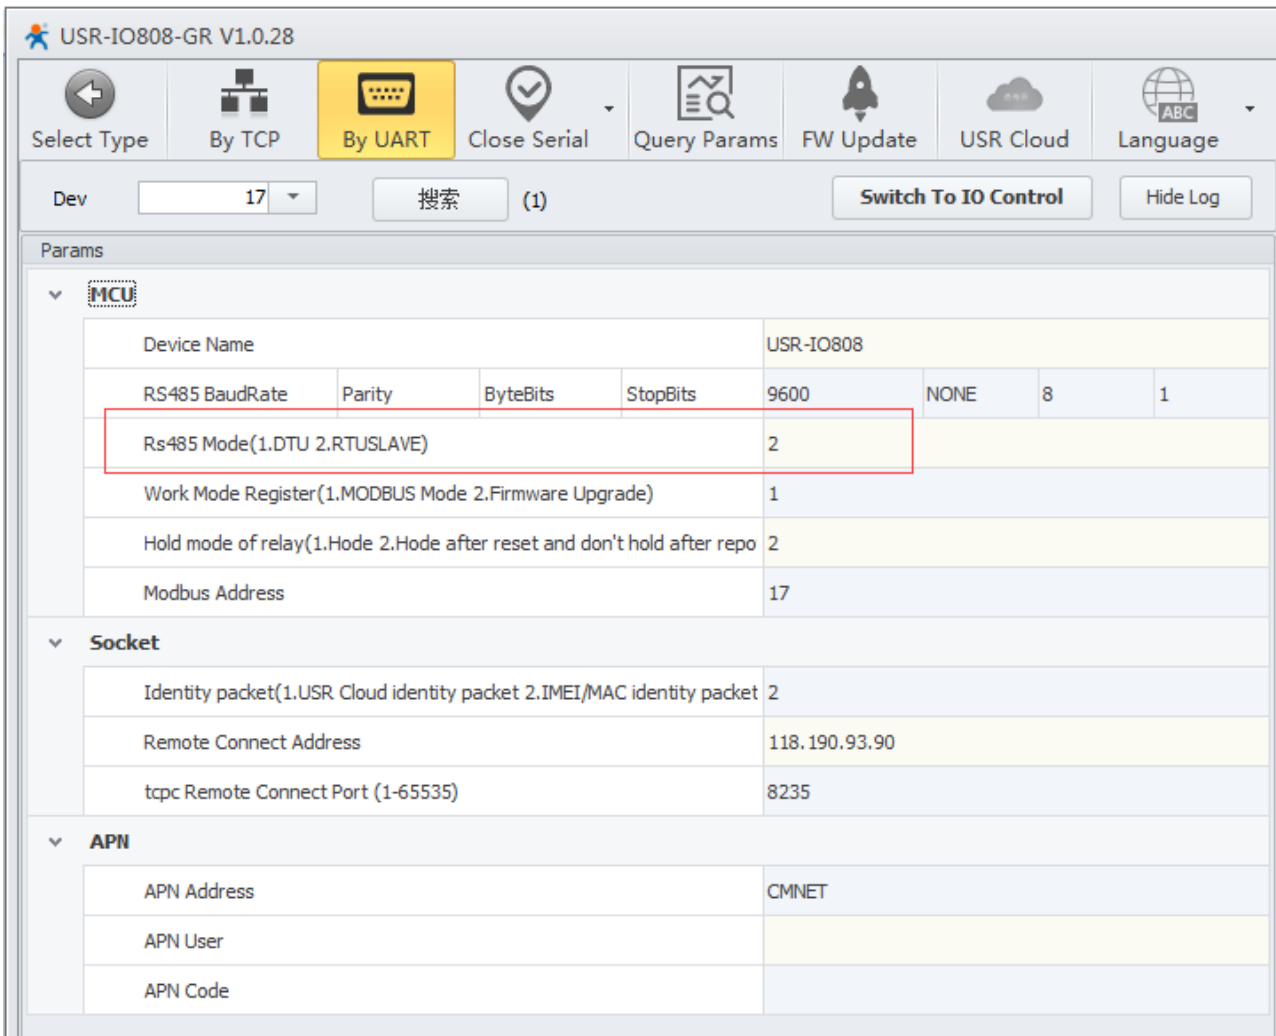

USR-IO808-GR V1.0.28

Select Type: **By UART** | By TCP | Close Serial | Query Params | FW Update | USR Cloud | Language

Dev: 17 | 搜索 (1) | Switch To IO Control | Hide Log

Params

- MCU**

Device Name	USR-IO808						
RS485 BaudRate	Parity	ByteBits	StopBits	9600	NONE	8	1
Rs485 Mode(1.DTU 2.RTUSLAVE)	2						
Work Mode Register(1.MOVBUS Mode 2.Firmware Upgrade)	1						
Hold mode of relay(1.Hode 2.Hode after reset and don't hold after repo)	2						
Modbus Address	17						
- Socket**

Identity packet(1.USR Cloud identity packet 2.IMEI/MAC identity packet)	2
Remote Connect Address	118.190.93.90
tcpc Remote Connect Port (1-65535)	8235
- APN**

APN Address	CMNET
APN User	
APN Code	

**Figure 19 Configure IO808-GR to Slave mode**

## 2.4. Upgrade firmware

User can refer to FAQ <<[Upgrading firmware method of USR-IO808-GR\\_V1.0.0](#)>>.

## 2.5. Serial port

### 2.5.1. Basic parameters

Parameter	Range
Baud rate	300~230400
Data bits	7, 8
Stop bits	1, 2
Parity	NONE, EVEN, ODD

Figure 20 Serial port basic parameters

### 2.5.2. Configuration method

Serial port parameters occupy two registers. Length of protocol is 4 bytes and specific protocol content as follow(All examples are in HEX format):

Name	Baud rate	Parameter bit
Number of bytes	3	1
Description	Three bytes represent a baud rate value and high-order in the former	Refer to <b>Figure Serial port parameter bit</b>
Example 1(115200, None, 8, 1)	01 C2 00	03
Example 2(9600, None, 8, 1)	00 25 80	03

Figure 21 Serial port parameters protocol

Bit number	Representation	Value	Description
1:0	Data bits	10	7 bits data bits
		11	8 bits data bits
2	Stop bits	0	1 bit stop bits
		1	2 bits stop bits
5:4:3	Parity	000	None
		001	ODD
		011	EVEN
7:6	No definition	00	Please write 0

Figure 22 Serial port parameter bit

## 2.6. Features

### 2.6.1. Relay output status hold

User can configure whether hold Relay output status: After restarting IO808-GR or powering on IO808-GR again, hold the Relay output status or reset to disconnect status.

- Register address: 182(0x00B6)
- Parameter values: 1(0x0001):All Relays hold status after restarting or powering off. 2(0x0002):All relays hold status after restarting and don't hold status after powering off.3(0x0003):All relays don't hold status after restarting or powering off.



- Supported function code: 0x03, 0x04, 0x06, 0x10

Configuration will take effect after restarting.

## 2.6.2. Conditional control

Conditional control function supports user configuring the conditions to trigger IO changes. It can make using IO808-GR more flexibly and extend application scenario. User only needs to modify conditional control function register parameters according to the instructions, it will realize corresponding function.

Conditional control function has 32 registers and 8 conditional control commands (Every command occupies 4 registers). Registers distribution as follow:

Storage content	Input register	Output register	Output action	Condition	Threshold	Reserved
<b>Length</b>	1 byte	1 byte	1 byte	1 byte	2 bytes	2 bytes
<b>Address</b>	Range: 16~109	Range: 1~16	1: Disconnect 2: Close 3: Reversal	1, 2, 255	'Compared register values'/The first two bytes of time-stamp	Reserved/ Last two bytes of time-stamp

**Figure 23 Conditional control function register**

- Output action (Relay output)
  - 1: Disconnect
  - 2: Close
  - 3: Reversal
- Condition
  - 1: Forward direction output follow
  - 2: Backward direction output follow
  - 255: Button action
- Control mode
  - Switching value control: DI input control DO output directly
  - Semaphore control: DI button semaphore control DO. Press button once, DO act once (Execute action in rising edge of releasing button).

Detailed explanation:

### 1. Forward direction output follow

Enable forward direction output follow: Set condition register to 1, input register is corresponding to one way register address of 8-way input and output register is corresponding to one way register address of 8-way output.

For example, if configure as 0x20 0x00 0x01 0x01 0x00 0x00 0x00 0x00, it represents status of DO1 will follow status of DI1 which means DO1 will close if DI1 close and DO1 will disconnect if DI1 disconnect.

### 2. Backward direction output follow

Enable backward direction output follow: Set condition register to 2, input register is corresponding to one way register address of 8-way input and output register is corresponding to one way register address of 8-way output.

For example, if configure as 0x20 0x00 0x01 0x02 0x00 0x00 0x00 0x00, it represents status of DO1 will be opposite as status of DI1 which means DO1 will close if DI1 disconnect and DO1 will disconnect if DI1 close.

### 3. Button control

Enable button control: Set condition register to 255, input register is DI button register and output register is DO output register. Action can be 1(disconnect ), 2(close), 3(reversal ), threshold register and reserved register can't work.

For example, if configure as 0x30 0x00 0x03 0xFF 0x00 0x00 0x00 0x00, it represents detecting DI1 button once will reverse status of DO1 once.


#### Note:

Input register is 0 means close this conditional control and execute button action once will clear button register. If multiple conditions will lead to paradoxical result, program will execute two results quickly. If forward direction output follow and backward direction output follow lead to paradoxical result, disconnecting and closing will revolve.

## 2.6.3. Connect to remote server

User can modify related register parameters of remote server to realize IO808-GR connecting to remote server. Procedure as follow:

1. Power the IO808-GR and connect IO808-GR's RS485 interface to PC. Run setup software(User can refer to **1.4.1.Control by serial**), modify remote server address and remote port as follow:

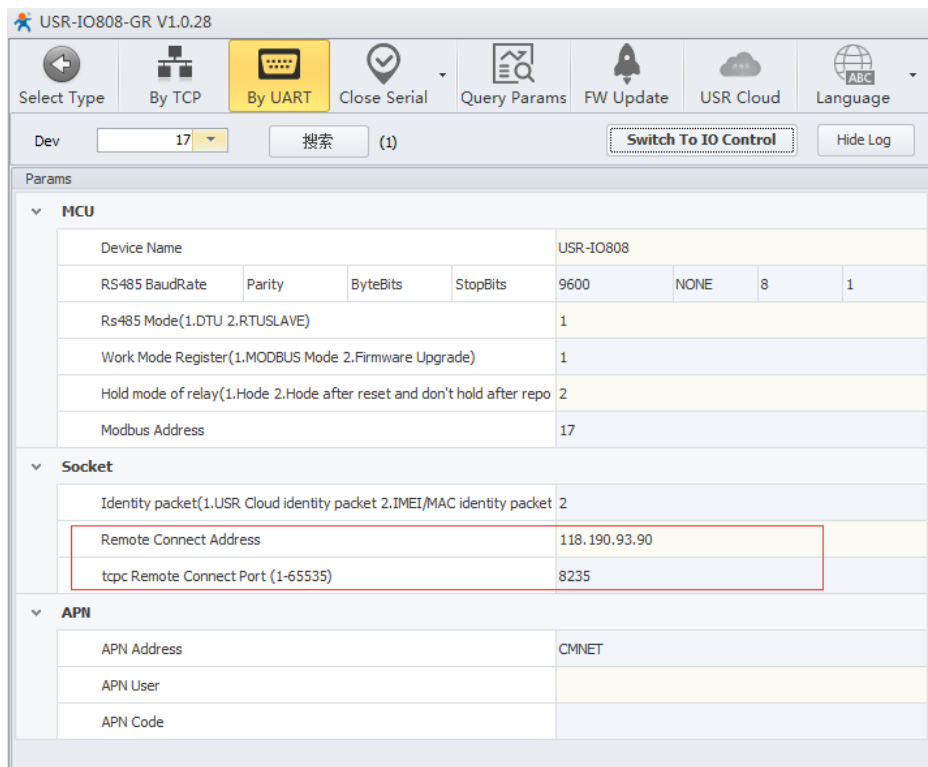

**Figure 24 Configure remote server parameters**

2. Restart IO808-GR to make configuration take effect.  
 3. Login remote server and open the port.

4. Wait IO808-GR LED 'NET' light which means IO808-GR connect to remote server successfully, Then user can transmit Modbus TCP/RTU command from server side to control IO808-GR and receive response from IO808-GR.


#### **2.6.4. Reset to default by hardware**

User can reset to default settings by pressing Reload button. After powering on, press Reload button 3 seconds to 15 seconds, then release it, IO808-GR will reset to default settings. Less than 3 seconds or more than 15 seconds will be considered as misoperation and don't handle it.

## **3. Modbus**

### 3.1. Modbus frame


Modbus RTU:

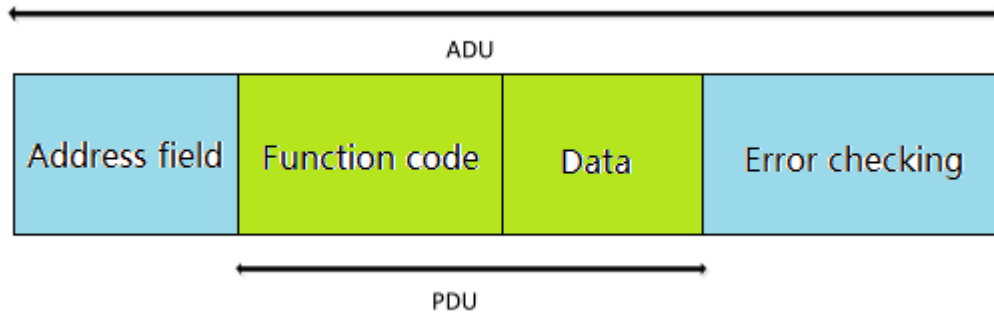

**Figure 25 Modbus RTU frame**

USR-IO808-GR data format conform to general Modbus frame format. IO808-GR can analyse Modbus RTU protocol and execute related operations.

Modbus TCP:

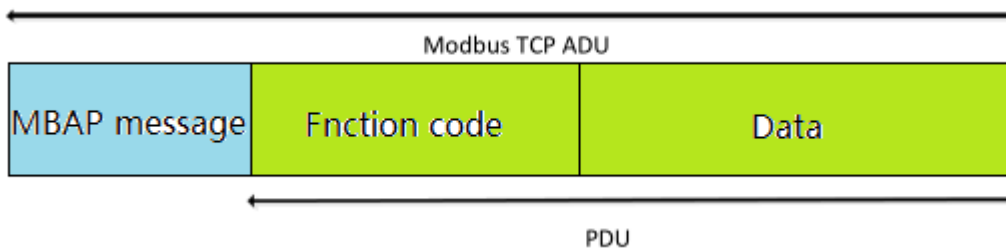

**Figure 26 Modbus TCP frame**

USR-IO808-GR can analyse received network Modbus TCP protocol data and transfer to Modbus RTU protocol to do data processing. IO808-GR can also be used in Master mode and transfer Modbus RTU protocol to Modbus TCP protocol and transmit to server.

### 3.2. Register distribution

USR-IO808-GR register instructions:

1. Register base address is 0x0000.
2. In following register distribution table, MCU parameters and communication module parameters must operate together.
3. Setup software USR-IO adopts UTF-8 coded format.
4. Register store HEX format data.

Register address	Register content	Parameter description	Applicable function code
<b>Device I/O</b>			
0x0000~0x0007	Switch value output	0xFF00 means ON, 0x0000 means OFF; 1 means ON, 0 means OFF	0x01, 0x05, 0x0F
0x0020~0x0027	Switch value input	1 means ON, 0 means OFF	0x02

0x0030~0x0037	Button input	Button detection. Reset to 0 after reading once	0x03, 0x04
0x0040~0x0047	Pulse counting	Count range: 0~0xFFFF. Reset to 0 after reaching maximum	0x03, 0x04
<b>MCU parameter</b>			
0x0068~0x0069	Time-stamp	Current time-stamp	0x03, 0x04
0x006A~0x006C	Year, month, day, hour, minute, second	The format of 'year, month, day, hour, minute, second' is Bcd code. Such as [0x18,0x01,0x01,0x08,0x24,0x56] represents 2018-1-1 8:24:56	0x03, 0x04, 0x10
0x006D	Week	0x0001-0x0007 represents Monday to Sunday	0x03, 0x04
0x008E~0x0091	Conditional control command 1	<b>Refer to 2.6.2. Conditional control</b>	0x03, 0x04, 0x10
0x0092~0x0095	Conditional control command 2		
0x0096~0x0099	Conditional control command 3		
0x009A~0x009D	Conditional control command 4		
0x009E~0x00A1	Conditional control command 5		
0x00A2~0x00A5	Conditional control command 6		
0x00A6~0x00A9	Conditional control command 7		
0x00AA~0x00AD	Conditional control command 8		
0x00AE~0x00AF	RS485 interface	Refer to <b>2.5.2. Configuration method</b>	0x03, 0x04, 0x10
0x00B0	RS485 mode	Master mode(0x0001) Slave mode(0x0002)	0x03, 0x04, 0x06, 0x10
0x00B1	Modbus address	Slave address(0x0001~0x00FD)	0x03, 0x04, 0x06, 0x10
0x00B2	Work mode	Modbus mode(0x0001) Firmware upgrade(0x0002)	0x03, 0x04, 0x06, 0x10
0x00B3	Global parameters configuration	Default(0x0000), restart(0x0001), reset to user default settings(0x0002), reset to USR default settings(0x5555), save current	0x03, 0x04, 0x06, 0x10

		settings as user default settings(0xAAAA)	
0x00B4	MCU software version	For example, 0x0112 means version V1.1.2	0x03, 0x04
0x00B5	MCU hardware version	For example, 0x0110 means version V1.1	0x03, 0x04
0x00B6	Relay status after restarting	All relays hold status after restarting or powering off(0x0001); All relays hold status after restarting and don't hold status after powering off(0x0002) All relays don't hold status after restarting or powering off(0x0003)	0x03, 0x04, 0x06, 0x10
0x00E7	PIN code	Character string format, 4~8 bits digital value	0x03, 0x04, 0x10
<b>Communication module parameters</b>			
0x1000~0x100A	APN address	Character string format	0x03, 0x04, 0x10
0x100B~0x1015	APN username	Character string format	0x03, 0x04, 0x10
0x1016~0x1020	APN password	Character string format	0x03, 0x04, 0x10
0x1043	Identity packet	USR Cloud identity packet(1); MAC identity packet(2); User editable identity packet(3); Disable identity packet(4)	0x03, 0x04, 0x06, 0x10
0x1055~0x1074	TCP Client remote server address	Remote server address	0x03, 0x04, 0x10
0x1075	TCP Client remote port	Remoter server port	0x03, 0x04, 0x06, 0x10
0x1088~0x1097	Device name	Character string format	0x03, 0x04, 0x10
0x1098	USR-IO808-GR software version	For example, 0x0112 means version V1.1.2	0x03, 0x04
0x1099	USR-IO808-GR hardware version	For example, 0x0110 means version V1.1	0x03, 0x04
0x10BA~0x10CD	User editable identity packet	Character string format	0x03, 0x04, 0x10
0x10CE	Identity packet sending method	Send identity packet after establishing connection(1)/Send before every data package(2)/Both way(3)	0x03, 0x04, 0x06, 0x10

**Figure 27 Register distribution**

## 4. Contact Us

Company: Jinan USR IOT Technology Limited

Address: Floor 11, Building 1, No. 1166 Xinluo Street, Gaoxin District, Jinan, Shandong, 250101, China

Web: [www.usriot.com](http://www.usriot.com)

Support: [h.usriot.com](http://h.usriot.com)

Email: [sales@usr.cn](mailto:sales@usr.cn)

Tel: 86-531-88826739/86-531-55507297

## 5. Disclaimer

This document provides the information of USR-IO808-GR products, it hasn't been granted any intellectual property license by forbidding speak or other ways either explicitly or implicitly. Except the duty declared in sales terms and conditions, we don't take any other responsibilities. We don't warrant the products sales and use explicitly or implicitly, including particular purpose merchant-ability and marketability, the tort liability of any other patent right, copyright, intellectual property right. We may modify specification and description at any time without prior notice.

## 6. Update History

2018-04-23 V1.0.3.01 established based on Chinese version V1.0.3.

2018-06-12 V1.0.5.01 updated based on Chinese version V1.0.5.